

Economic-Ecological Study of the Solutions Proposed by HOMER for the Optimization of an Industrial Installation

Othmane Echarradi*,¹, Abdessamad Benlafkih², Mounir Fahoume¹

¹Laboratory of Material Physics and Subatomic, Faculty of Sciences, Ibn-Tofail University, Kenitra, 14000, Morocco

²Advanced Systems Engineering Laboratory, Faculty of Sciences, Ibn-Tofail University, Kenitra, 14000, Morocco

ARTICLE INFO

Article history:

Received: 14 November, 2022

Accepted: 07 January, 2023

Online: 24 January, 2023

Keywords:

Hybrid system

Homer software

Greenhouse gas

Green energy sale

ABSTRACT

The need to protect the environment against human-induced pollution is no longer to be demonstrated. Radical solutions are expected soon to mitigate the impact of climate change in the first step and then gradually improve the ecological situation in the second step. Several efforts on the part of governments and the scientific community are being deployed to better serve the planet. It is in this sense that this work is registered to bring a contribution to this field of study. This paper contains important results on the contribution that a hybrid solution can bring to the environment by taking into consideration the two economic and especially ecological aspects. Through the sequence of this work, we will see that larger amounts of CO₂ can be avoided if approaches that are more judicious are used. This will include criticism from an ecological point of view of the HOMER software considering the results it proposes.

1. Introduction

Solving the energy dilemma which opposes, on the one hand, providing the need for energy to everyone, which has become vital in some areas [1], and on the other hand, reducing greenhouse gases to avoid an inevitable catastrophe, is becoming the focus of the most important scientific research nowadays [2]. One thing is sure, the resolution of this dilemma will not come with a snap of the fingers but with sacrifices especially of economic nature. For example, China will have to do without the biggest world reserve of coal to the profits of energies said green [3]. The change, as we well understand, requires a lot of effort and will go through many stages before a satisfactory result for the environment. This work, which is part of one of these transitional stages, come to contribute to the efforts already made by scientists around the world.

The main goal of this study is to make clear the ecological contribution of green solutions [4], here a hybrid system [5], to show the importance of such action for the planet earth [6]. However, not all hybrid solutions contribute in the same way. Indeed, if the ecological aspect is not taken into account, the results of the optimization, will not be necessarily the best for the environment, and this is exactly what will be demonstrated for the

case study of this work, and more precisely during the manipulation of the HOMER software. The conducted study will also determine what is best for the climate in our project by defining the best possible combinations of energies that contribute to avoiding the most greenhouse gases.

2. Method

In this section, the choice of the location of the project will be justified. This location was not chosen trivially, but because it has a large solar and wind field throughout the year. Through this section, HOMER [7] will optimize the hybrid system. Other solutions for the optimization of hybrids systems can be used but HOMER has been chosen. This is justified by the fact that this software [8] is very efficient and widely used by scientists.

2.1. Situational setting

We want to build a new factory of prefabricated building materials (bricks, pipes...). However, being a fervent supporter of ecology, the owner requires that his new factory is as environmentally friendly as possible [9,10]. This plant is running 24 hours a day, so only a hybrid solution [11] can meet the man's requirements.

* Corresponding Author: Othmane Echarradi, echarradi.othmane@gmail.com

2.1.1. Geographic data

The factory in question is located in Diabat, in the region of Essaouira, Morocco as shown in Figure 1. The factory covers an area of 12 hectares. Five areas cover this surface, namely:

- Factory A: Brick manufacturing
- Factory B: Manufacture of reinforced concrete pipes
- Plant C: Manufacture of polyethylene pipes
- External area
- Administrative area

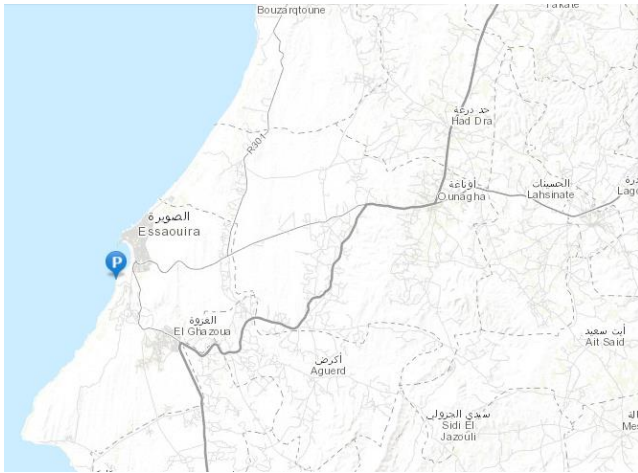


Figure 1: Mapping the Diabat area, Essaouira, Morocco

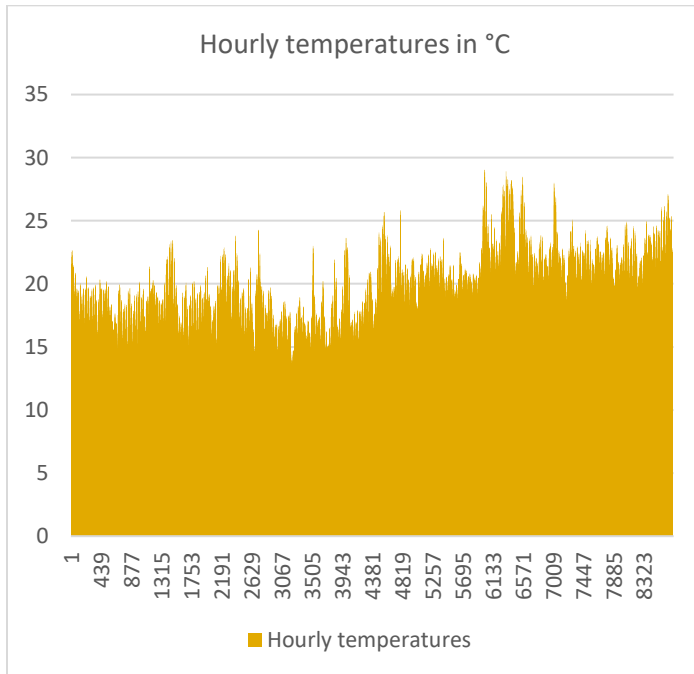


Figure 2: Hourly temperature profile for a full year

2.1.2. Meteorological data

In this region, the summers are quite hot and arid while the winters are cool and clear on the whole. The climate is windy

throughout the year. The following figures give an idea of the weather in Essaouira.

➤ Profile of the temperature

Figure 2 below shows the temperature profile for this region. The temperatures were taken for the period between 1/11/2021 and 1/11/2022, i.e., one year. Note that these data are taken from the NASA website.

➤ Wind pattern

Figure 3 below shows the hourly wind speed profile at 10m above ground level for the study area. The period of record is from 01/11/2021 to 01/11/2022. In this case, NASA is the source of these samples.

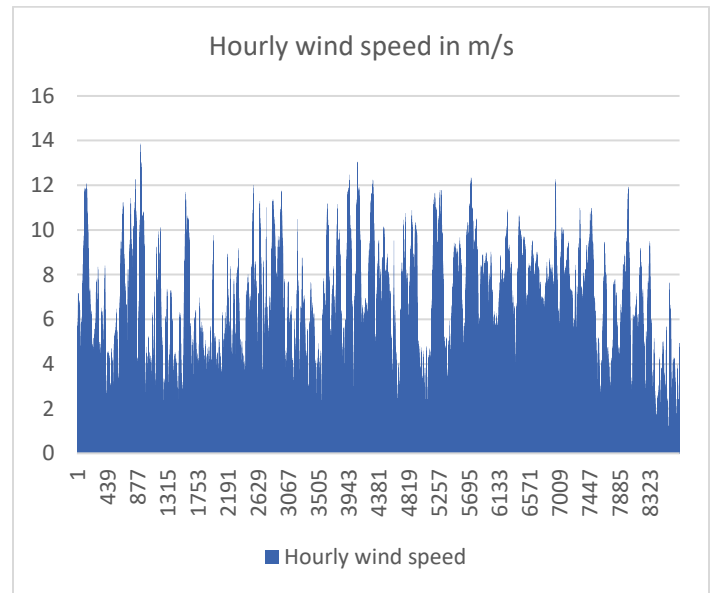


Figure 3: Hourly wind speed profile for a full year

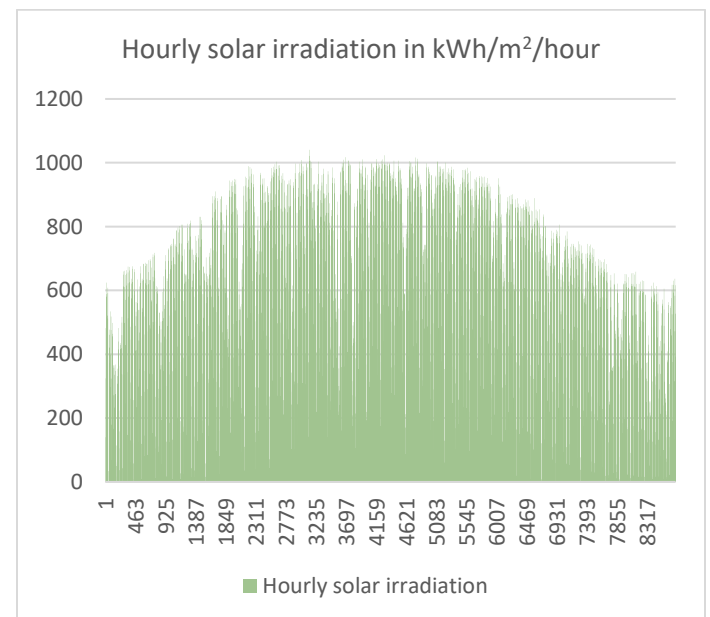


Figure 4: Hourly solar irradiation profile for a full year

➤ Solar irradiation profile

Figure 4 below shows the hourly solar irradiation for the study area. The period of record is from 01/01/2021 to 01/01/2022. In this case also, the NASA is the source of these samples.

2.1.3. Consumption profile

The operating hours of the five areas differ, since plants A and B operate for 12 hours from 7am to 7pm, the plant C operates continuously, i.e., 24 hours a day, the outdoor area operates from 6pm to 6am, while the administrative area has service hours from 8am to 4pm. These data give the following consumption profile [12,13]. This profile is illustrated in figure 5.

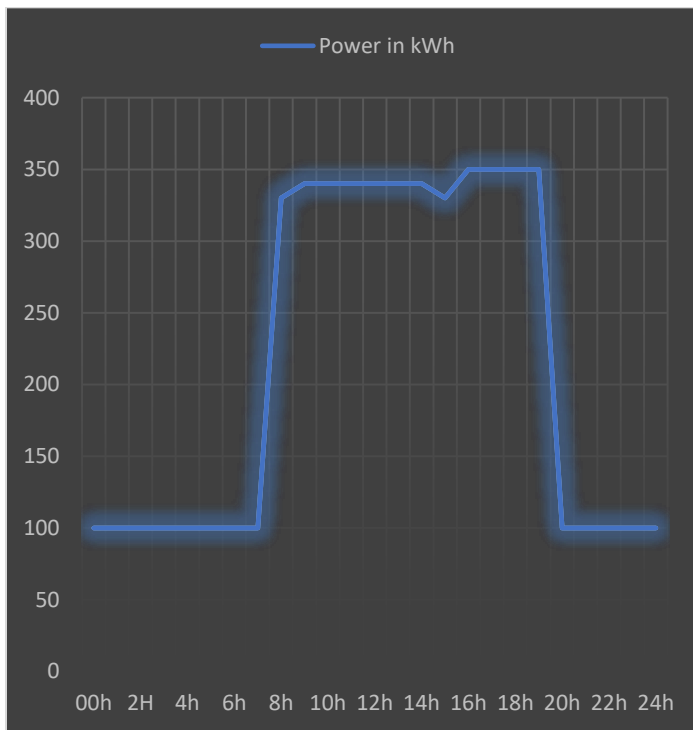


Figure 5: Electricity consumption profile

2.2. Optimization of the hybrid system

In this part, the optimization of the hybrid system [14] will take place. The components of this system have been carefully selected. The characteristics of these elements will be exposed in the following.

2.2.1. Technical characteristics of the elements of the system

- **Wind turbine:** For this component, the choice fell on the wind turbine XANT L-33 [330kW], the diameter of its rotor is 33m, the wind turbine power curve is shown in figure 6 below, and its life span is at least 20 years, while the price of this turbine is 750000 USD.
- **Photovoltaic panels:** The Italian brand PEIMAR was preferred for this element, the chosen model is the SG370M which is composed of 72 cells of monocrystalline type, its nominal output (Pmax) is 380W, the module efficiency is 19,07%, its life span is 30 years, its I-V characteristic for different radiations is shown in figure 7. Note that it costs 640USD for a kilowatt-hour.

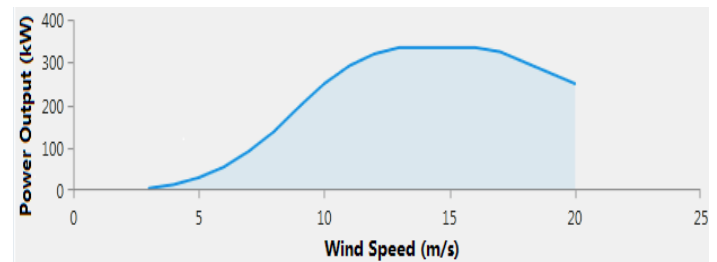


Figure 6: The wind turbine power curve

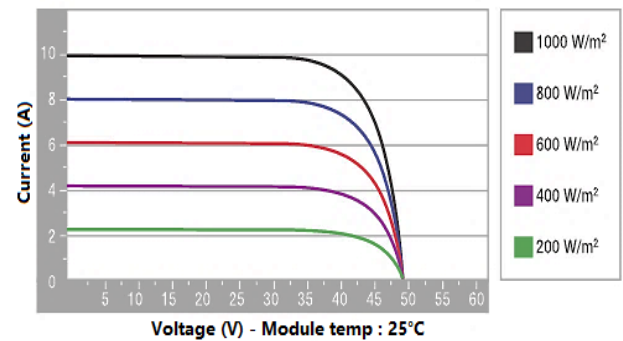


Figure 7: I-V characteristic of the photovoltaic generator for different radiations

Architecture							Cost				System	
	SG370M (kW)	XANT330	Iron2100	Grid (kW)	Leon680 (kW)	Dispatch	COE (\$)	NPC (\$)	Operating cost (\$/yr)	Initial capital (\$)	Ren Frac (%)	Total Fuel (L/yr)
	5 464			999 999	2 778	CC	0,00312 \$	319 513 \$	-418 314 \$	5,16 \$M	92,7	0
	5 460		1	999 999	2 778	CC	0,00360 \$	368 841 \$	-420 039 \$	5,23 \$M	92,7	0
	5 225	1		999 999	2 778	CC	0,00476 \$	495 833 \$	-454 632 \$	5,76 \$M	95,2	0
	5 341	1	1	999 999	2 778	CC	0,00520 \$	546 233 \$	-462 888 \$	5,91 \$M	95,2	0
				999 999		CC	0,120 \$	2,83 \$M	244 054 \$	0,00 \$	0	0
			1	999 999	1,63	CC	0,122 \$	2,88 \$M	242 169 \$	72 678 \$	0	0
		1		999 999	38,6	CC	0,140 \$	3,30 \$M	218 571 \$	773 150 \$	10,9	0
		2	3	999 999	62,7	CC	0,170 \$	4,01 \$M	194 984 \$	1,75 \$M	18,5	0

Figure 8: Optimal solutions proposed by HOMER from P1 to P8

- **Storage:** Iron Edison LFP 2100Ah was chosen, it's a Lithium iron Battery, its nominal voltage is 48V, its nominal capacity is 101kWh, its life span is 10 years and it costs 71700USD per unit.
- **Grid:** The public electricity distributor is here the O.N.E.E affiliated with the Moroccan state, the purchase of 1kWh costs 0.12 USD while the sale of 1kWh costs 0.08 USD (assumption for this study since the sale of electricity is still not allowed in Morocco).
- **Converter:** The chosen inverter is the Leonics GTP-518HET(P) 680Kw, it's a PV-dedicated, three-phase, grid-connected, and it has an integrated MPPT, which is generally dictated by one of three well-known algorithms among them the perturbation and observation (P&O) whose algorithm is represented in figure 9 below, AC output 680Kw, output 380V_AC, lifetime assumed to be 10 years and it cost 600USD/kW.

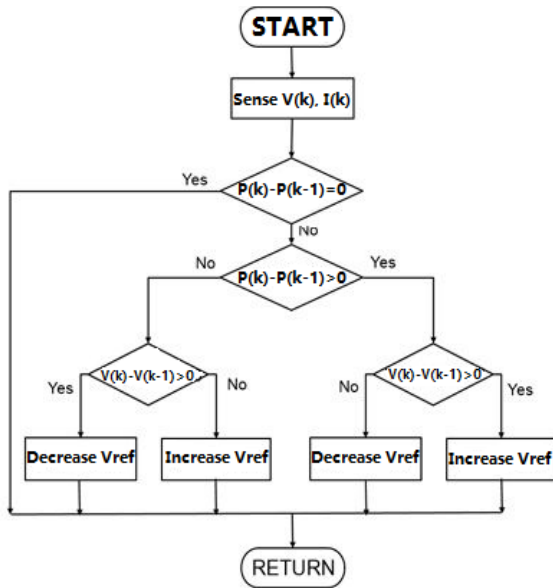


Figure 9: The perturbation and observation (P&O) algorithm

2.2.2. HOMER Simulation

The optimization, as we have already mentioned, will be executed by the software HOMER, as it is the best tool for hourly evaluation of hybrid and renewable electricity production systems in the world - without exception. Right after project simulation [15], we obtain as expected a multitude of proposals, more exactly 8 considered as the best as shown in figure 8. The solutions are ranked from the best economic solution that we note P1 to the least good that we note P8.

- The first proposal uses a combination of solar energy and energy produced by the public grid with a percentage of 94% and 6% respectively.
- The second proposal uses in addition to solar energy and energy produced by the public grid storage batteries.

- The third proposal uses a combination of solar energy, wind energy, and energy produced by the public grid with respective percentages of 89%, 7%, and 4%.
- The fourth proposal uses a combination of solar energy, wind energy, and energy produced by the public grid, with additional storage batteries.
- The fifth proposal uses only energy produced by the public grid.
- For the sixth proposal, energy production is done thanks to the energy produced by the public grid combined with storage batteries.
- For the seventh proposal, the energy production is due to the combination of solar energy and energy produced by the public grid with respective percentages of 71% and 29%.
- For the eighth proposal, the energy production is due to solar energy and the energy produced by the public grid combined with storage batteries.

2.2.3. Amount of CO2 avoided

The goal of this part is to be able to extract the solution that allows us to avoid the greatest amount of CO₂. Table 1, which has as sources the AMEDE and the GIEG, provides important information about the CO₂ emission [16,17] of each type of energy source.

Table 1: Quantity of CO₂ emissions for each energy source given by the AMEDE and the GIEG

Sources of energy	CO ₂ emissions per kWh
Onshore wind turbine	12.7g
Offshore wind turbine	14.8g
Fossil gas	490g
Coal	820g
Photovoltaic solar	43.9g
Oil	510g
Hydraulic	43g
Concentrating Solar	22g

Table 2: Contribution of each energy source for one kWh in Morocco

Sources of energy	Contribution to the production	Emission contribution in one kWh produced
Coal	67.6%	554.32
Oil	1.5%	7.65
Onshore wind turbine	11.6%	1.47
Fossil gas	11.8%	57.82
Hydraulic	3.2%	1.37
Concentrating Solar	4.3%	0.946

The first step to determining the amount of CO₂ avoided is to determine the carbon footprint of the energy purchased from the Moroccan public grid. Table 2 is devoted to this subject:

After calculation, the carbon footprint of a Kilowatt-hour of electricity produced in Morocco is: 623.58g/kWh

Table 3 below summarizes the amount of energy produced in detail from each of the 8 proposals. Based on these figures, it will be possible to determine the amount of CO₂ avoided by each of the proposals and to extract by then the highest value.

Table 3: Amount of energy produced per year in detail from each of the 8 proposals

	Solar energy production in kWh	Wind power production in kWh	Grid purchases in kWh	Total in kWh
P1	9 977 598	0	644 029	10 621 628
P2	9 978 072	0	644 026	10 622 098
P3	9 656 199	731 560	436 493	10 824 252
P4	9 870 781	731 560	435 518	11 037 860
P5	0	0	2 033 780	2 033 780
P6	0	0	2 033 780	2 033 780
P7	0	731 560	1 811 995	2 543 556
P8	0	1 463 121	1 658 227	3 121 348

By calculation, it turns out that P4 is the proposal that avoids the most CO₂ with more than 6440 tons/year.

3. Results and Discussion

As the first result of this study, we notice that HOMER [18], although it is a software program oriented towards the promotion of green energy [19,20], does not propose as the first choice the solution that allows the most CO₂ to be avoided. The first solution proposed by the software avoids 6185 tons/year of greenhouse gases as opposed to 6440 tons/year for the solution found previously, which is a difference of 255 tons/year which constitutes no less than 5100 tons for the life of the project, which is a gigantic figure. To push the study even further and to shed light on this highly rated software, the next step will be the calculation of the cost price of a ton of CO₂ avoided, this calculation will be made in table 4 below.

We note that this qualitative study reinforces the quantitative study already conducted. Indeed, this ecological-economic study does not give an advantage to the best solution proposed by the software but, on the contrary, puts the first four solutions on an equal footing, with even a slight advantage for the last three. Indeed, as the previous table shows, the price to avoid one ton of CO₂ is higher for the first software proposal. It can be said then that to carry out a rigorous ecological study, a post-HOMER study is necessary to obtain results that are more beneficial to the environment.

Table 4: Calculation of the cost price of a ton of CO₂ avoided

	Investment in USD (A)	The potential financial gain in USD (B)	(A) – (B) in USD	Amount of CO ₂ avoided over the life of the project in tons	The cost price of one ton of CO ₂ avoided in USD
P1	6 788 695	10 272 938	-3 484 243	123 708.2	-28.16
P2	6 860 560	10 342 459	-3 481 899	125 017.5	-27.85
P3	7 427 400	11 056 980	-3 629 580	126 331.6	-28.73
P4	7 573 406	11 261 474	-3 688 068	128 807.4	-28.63
P5	0	0	0	0	0
P6	72677	0	72677	0	0
P7	796 338	0	796 338	31 536.2	25.25
P8	1 790 336	0	1 790 336	38 556.4	46.43

Although this solution is not the best economically, its financial aspect is not to be neglected, since the cash flow remains very interesting, as shown in figure 10 below. Indeed, by favoring the solution that avoids the most CO₂, the project can generate a profit of 3 688 068 USD over 20 years, which is a very important sum. So we notice that we can help the planet and at the same time make important financial gains. These sums put at stake can be a source of motivation for potential investors.

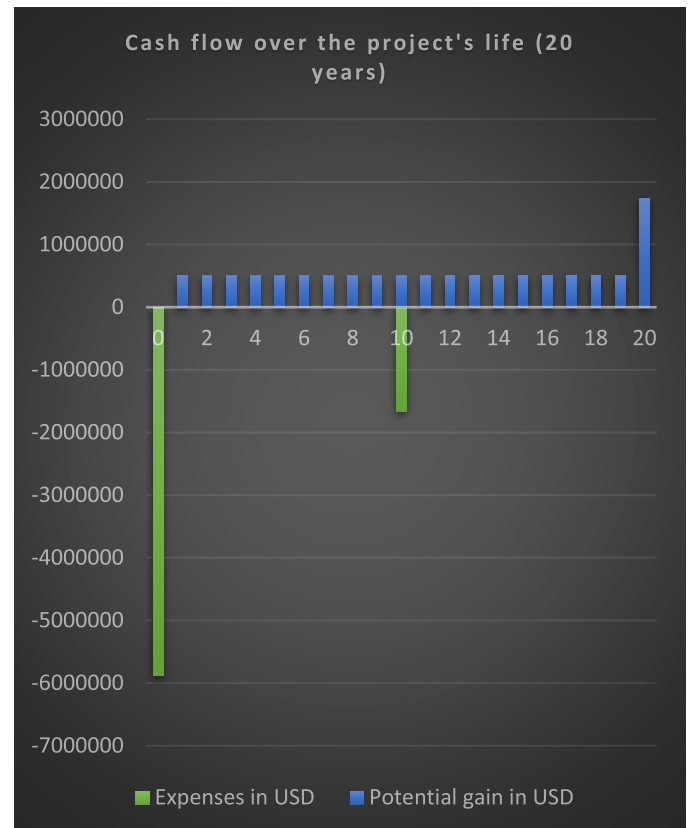


Figure 10: Cash flow of the chosen solution

4. Conclusion

During this study, it was shown that a significant amount of greenhouse gases can be avoided if the choice of the hybrid system used is appropriate. This choice, as we have seen, is not automatically delivered by the HOMER software. Indeed, it has been demonstrated that this well-known software does not allow to obtain the best results ecologically speaking and a posterior study is mandatory. This said and although this work is undoubtedly important it remains only a fraction of the submerged part of the iceberg, and without a real will to change, nothing would be possible, thus and for the good of the planet, a global energy plan should be put in place as soon as possible, and this will also involve the design of more environmentally friendly software or the improvement of existing software, these efforts on the part of scientists around the world will undoubtedly help to achieve a more rapid change. To be indifferent to the current climatic situation is in fact to neglect the future of the generations to come, these last ones will find themselves despite them being in a very critical situation.

Conflict of Interest

The authors declare no conflict of interest.

References

- [1] A. Alamsyah, M. Subito, M. Ikhlaiy, E. Setijadi, "Internet of things-based vital sign monitoring system," *International Journal of Electrical and Computer Engineering (IJECE)*, **10**(6), 5891, 2020, doi:10.11591/ijece.v10i6.pp5891-5898.
- [2] A.M. Baniyounes, Y.Y. Ghadi, A.A. Baker, "Institutional smart buildings energy audit," *International Journal of Electrical and Computer Engineering (IJECE)*, **9**(2), 783, 2019, doi:10.11591/ijece.v9i2.pp783-788.
- [3] Q.-J. Wang, G.-F. Feng, H.-J. Wang, C.-P. Chang, "The influence of political ideology on greenhouse gas emissions," *Global Environmental Change*, **74**, 102496, 2022, doi:10.1016/j.gloenvcha.2022.102496.
- [4] G. Reina, M. Mauleudoux, O.A. Aviles, "Simulation of a microgrid for a non-interconnected zone that integrates renewable energies," *International Journal of Electrical and Computer Engineering (IJECE)*, **11**(1), 201, 2021, doi:10.11591/ijece.v11i1.pp201-216.
- [5] S.B. Utomo, I. Setiawan, B. Fajar, S.H. Winoto, A. Marwanto, "Optimizing of the installed capacity of hybrid renewable energy with a modified MPPT model," *International Journal of Electrical and Computer Engineering (IJECE)*, **12**(1), 73, 2022, doi:10.11591/ijece.v12i1.pp73-81.
- [6] Seyed Mohsen Mousavi Khormandichali, Mehrdad Ahmadi Kamarposhti, "Optimal placement of wind generation units in order to increase revenues and reduce the imposed costs in the distribution system considering uncertainty," *International Journal of Electrical and Computer Engineering (IJECE)*, **9**(6), 2019.
- [7] M. Mallek, M.A. Elleuch, J. Euch, Y. Jerbi, "Optimal design of a hybrid photovoltaic-wind power system with the national grid using HOMER: A case study in Kerkennah, Tunisia," in 2022 International Conference on Decision Aid Sciences and Applications (DASA), IEEE: 725–729, 2022, doi:10.1109/DASA54658.2022.9765310.
- [8] M. Purlu, S. Beyarslan, B.E. Turkay, "Optimal Design of Hybrid Grid-connected Microgrid with Renewable Energy and Storage in a Rural Area in Turkey by Using HOMER," in 2021 13th International Conference on Electrical and Electronics Engineering (ELECO), IEEE: 263–267, 2021, doi:10.23919/ELECO54474.2021.9677788.
- [9] A. Kabulov, I. Saymanov, "Application of IoT technology in ecology (on the example of the Aral Sea region)," in 2021 International Conference on Information Science and Communications Technologies (ICISCT), IEEE: 1–5, 2021, doi:10.1109/ICISCT52966.2021.9670139.
- [10] Q. Mei, L. Lin, "Intelligent System of Ecological Civilization Construction based on Communication System Optimization Model," in 2021 5th International Conference on Trends in Electronics and Informatics (ICOEI), IEEE: 1686–1689, 2021, doi:10.1109/ICOEI51242.2021.9452843.
- [11] K. Nagasujatha, V.B. Shalini, "Technical performance evaluation and economic viable solutions using hybrid renewable energy systems," in 2015 IEEE Power, Communication and Information Technology Conference (PCITC), IEEE: 801–807, 2015, doi:10.1109/PCITC.2015.7438105.
- [12] K. Sinitsyna, A. Petrochenkov, B. Krause, "Some Practical Aspects of Electric Power Consumption Time Series Analysis," in 2019 IEEE 60th International Scientific Conference on Power and Electrical Engineering of Riga Technical University (RTUCon), IEEE: 1–10, 2019, doi:10.1109/RTUCon48111.2019.8982264.
- [13] Y. Ruan, F. Liu, "Clustering analysis for building energy benchmarking based on weekly load profile," in 2021 International Conference on Computer Information Science and Artificial Intelligence (CISAI), IEEE: 380–384, 2021, doi:10.1109/CISAI54367.2021.00079.
- [14] H. Sommer, M. Winkelkotte, F. Bauer, P. Bretschneider, "Hybrid-approach for unit commitment simulation combining a fundamental model with a neural network," in 11th Solar & Storage Power System Integration Workshop (SIW 2021), Institution of Engineering and Technology: 174–180, 2021, doi:10.1049/icp.2021.2498.
- [15] G. Vakili-Nezhaad, S.B. Mishra, H. Mousa, H. Ziaiefar, "Simulation and optimization of hybrid green energy systems for desalination purposes," *Environmental Progress & Sustainable Energy*, **40**(2), 2021, doi:10.1002/ep.13515.
- [16] N.A. Aquilas, J.T. Atemnkeng, "Climate-related development finance and renewable energy consumption in greenhouse gas emissions reduction in the Congo basin," *Energy Strategy Reviews*, **44**, 100971, 2022, doi:10.1016/j.esr.2022.100971.
- [17] D. Ospina, S. Zapata, M. Castañeda, I. Dynner, A.J. Aristizabal, N. Escalante, "Model for Evaluating CO2 Emissions and the Projection of the Transport Sector," *International Journal of Electrical and Computer Engineering (IJECE)*, **8**(3), 1781, 2018, doi:10.11591/ijece.v8i3.pp1781-1787.
- [18] M.D. Abnavi, N. Mohammadshafie, M.A. Rosen, A. Dabbaghian, F. Fazelpour, "Techno-economic feasibility analysis of stand-alone hybrid wind/photovoltaic/diesel/battery system for the electrification of remote rural areas: Case study Persian Gulf Coast-Iran," *Environmental Progress & Sustainable Energy*, **38**(5), 13172, 2019, doi:10.1002/ep.13172.
- [19] J. Li, K. Dong, X. Dong, "Green energy as a new determinant of green growth in China: The role of green technological innovation," *Energy Economics*, **114**, 106260, 2022, doi:10.1016/j.eneco.2022.106260.
- [20] K.Y. Chau, M. Moslehpour, Y.-T. Tu, N.T. Tai, N.H. Tien, P.Q. Huy, "Exploring the impact of green energy and consumption on the sustainability of natural resources: Empirical evidence from G7 countries," *Renewable Energy*, **196**, 1241–1249, 2022, doi:10.1016/j.renene.2022.07.085.